Profil longitudinal 1
Longitudinal profile no. 1

Profil longitudinal 2
Longitudinal profile no. 2

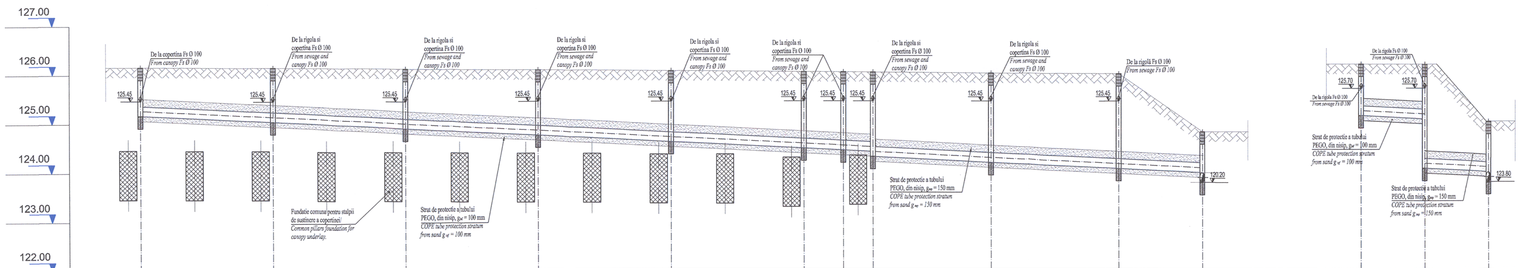

DENUMIRE CAMIN / NUMBER OF CHAMBER		P3		P4		P5		P6		P7		P8		P9		P10		P11		P12		318N		P2		P1		311N
COTA TEREN AMENAJAT / APPLIANCE GROUND QUOTA	126.16		126.12		126.10		126.08		126.05		126.03		126.024		126.019		126.01		125.99		124.81		126.19		126.20		125.03
COTA CAPAC CAMIN / CHAMBER COVER QUOTA	126.16		126.12		126.10		126.08		126.05		126.03		126.024		126.019		126.01		125.99		124.81		126.19		126.20		125.03
COTA RADIER CAMIN (tub) / CHAMBER FOUNDATION QUOTA (tube)	125.17		125.03		124.89		124.76		124.62		124.49		124.45		124.42 / 124.32		124.20		124.07		123.98 / 123.78		125.14		125.07 / 124.97		124.00 / 123.80
ADANCIME CAMIN / DEPTH OF THE CHAMBER	0.99		1.09		1.21		1.32		1.43		1.54		1.574		1.70		1.81		1.82		0.83 / 1.03		1.05		2.13		1.23
DISTANTA INTRE CAMINE / ON THE CENTER CHAMBER DISTANCE		27 m		27 m		27 m		27 m		27 m		8 m		6 m		24 m		26 m		17 m				13 m		13 m	
DISTANTE CUMULATE / LENGTH ADDED	0 m		27 m		54 m		81 m		108 m		135 m		143 m		149 m		173 m		199 m		216 m		0 m		13 m		26 m
PANTA TUB CANALIZARE / SEWAGE SLOAPE																											
DIAMETRU + MATERIAL TUB CANAL / DIAMETER+TUBE MATERIAL		Tub PEGO, tip SN4, Ø 200 mm/ COPE tube, SN4 type, Ø 200 mm																									

5 ‰

5 ‰

Tub PEGO, tip SN4, Ø 200 mm/
COPE tube, SN4 type, Ø 200 mm

EXECUTAREA LUCRARILOR DE MONTAJ A RETELELOR DE ALIMENTARE CU APA SI CANALIZARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTOR TIPURI DE LUCRARI.

THE EXECUTION OF THE FIXING WORKS FOR WATER SUPPLY AND SEWERAGE NETWORK WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPES OF WORKS.

NOTA /*NOTE*:

* Prezentul plan se va consulta impreuna cu planurile: PT.2A.03.04.IS.14.001 şi PT.2A.03.04.IS.14.003
* Legenda se va citi in planul: PT.2A.03.04.IS.14.001.
* *The present design will be consult with the following drawings: PT.2A.03.04.IS.14.001 and PT.2A.03.04.IS.14.003*
* *The cartouche will be consult in the drawing no: PT.2A.03.04.IS.14.001.*

* Cerinta de calitate minima corespunzator nivelului de performanta este **Is** - in conformitate cu prevederile H.G. 925 - 1995.
* Categoria de importanta a lucrarilor hidrotehnice este **"C"** (normala) - in conformitate cu prevederile STAS 2473 - 1983.
* *Minimum quality requirement adequate performance level are **Is** - in correspondance with G.R. 925 - 1995.*
* *Importance class for hydrotechnical works is **"C"** (normal) - in correspondance with STAS 2473 - 1983 forecast.*

FLIDOR CONSTANTIN ROMÂNIA MUPAA Nr. 1760 INGINER VERIFICATOR PROIECTE

Verificator / Expert Checker / Expert	Cerinta Requirement	Semnatura Signature	Referat / Expertiza Report / Expertise

European Investment Bank

MINISTERUL TRANSPORTURILOR

BENEFICIAR / BENEFICIARY :

COMPANIA NATIONALĂ DE CĂI FERATE "CFR" SA

PROIECTANT / DESIGNER: PÖYRY			Data Date	Semnatura Signature
Aprobat Approved	Sef de echipa Team leader	C. Teodorescu	01.2013	
Verificat Checked	Expert Cheie Key Expert	B. Goessler	01.2013	
Subcontractant / Subcontractor VIOTOP				
Aprobat Approved	Adjunct Sef de echipa Deputy Team leader	A.M. Baicu	01.2013	
Proiectat Designed	Inginer Engineer	Fl. Duta	01.2013	

"Reabilitarea liniei c.f. Frontier ă - Curtici - Simeria , parte componentă a coridorului IV Pan - European pentru circula ţia trenurilor cu viteză maximă de 160 km/h" Tronsonul 2-A : km 614 - Cap Y Bărzava

"Rehabilitation of the Railway Line Border - Curtici - Simeria , component Part of the IV Pan - European Corridor for the Trains Circulation with maximum speed of 160 km/h" Section 2-A : km 614 - End Y Bărzava

Project 9i 35311.1

Faza / Phase: PTH+CS / TD+TS

Denumire desen / Drawing name:

Statia CFR PĂULIŞ. Retea exterioara de canalizare pluviala. Profile longitudinale prin canalizare 1 - 2.

PĂULIŞ Railway Station. Rainwater sewerage network. Longitudinal profiles no. 1 - 2.

Scara / Scale	Revizia / Revision	Cod desen / Drawing Code	Nr / No
Oriz - 1: 500; Vert. - 1: 50		PT.2A.03.04.IS.14.002	01/01