


# LEGENDĂ

- I - Ventilator centrifugal de perete pentru grup sanitar, debit 250 m<sup>3</sup>/h, echipat cu grilă antiretur și protecție antivibrații;  
 II - Ventilator axial de perete pentru baie, debit 200 m<sup>3</sup>/h;
- Coloană ventilare băi și grupuri sanitare;  
 - Aer evacuat în suprapresiune din băi, grupuri sanitare;
- Grilă de aluminiu, cu închidere gravitațională, montată în ușă (ptr. introducerea aer de compensare) - 100x300mm



# LEGEND

- I - Wall mounted centrifugal ventilator for sanitary group, flow of 250 m<sup>3</sup>/h, equipped with anti-return grid and anti-vibrations protector;
- II - Wall mounted axial ventilator for bathroom, flow of 200 m<sup>3</sup>/h;
- Ventilation column for bathrooms and sanitary groups;
- Overpressure exhausting of the air from bathrooms and sanitary groups;
- Aluminium grid with gravitational closure mounted on door (in order to introduce the compensation air) - 100x300mm.

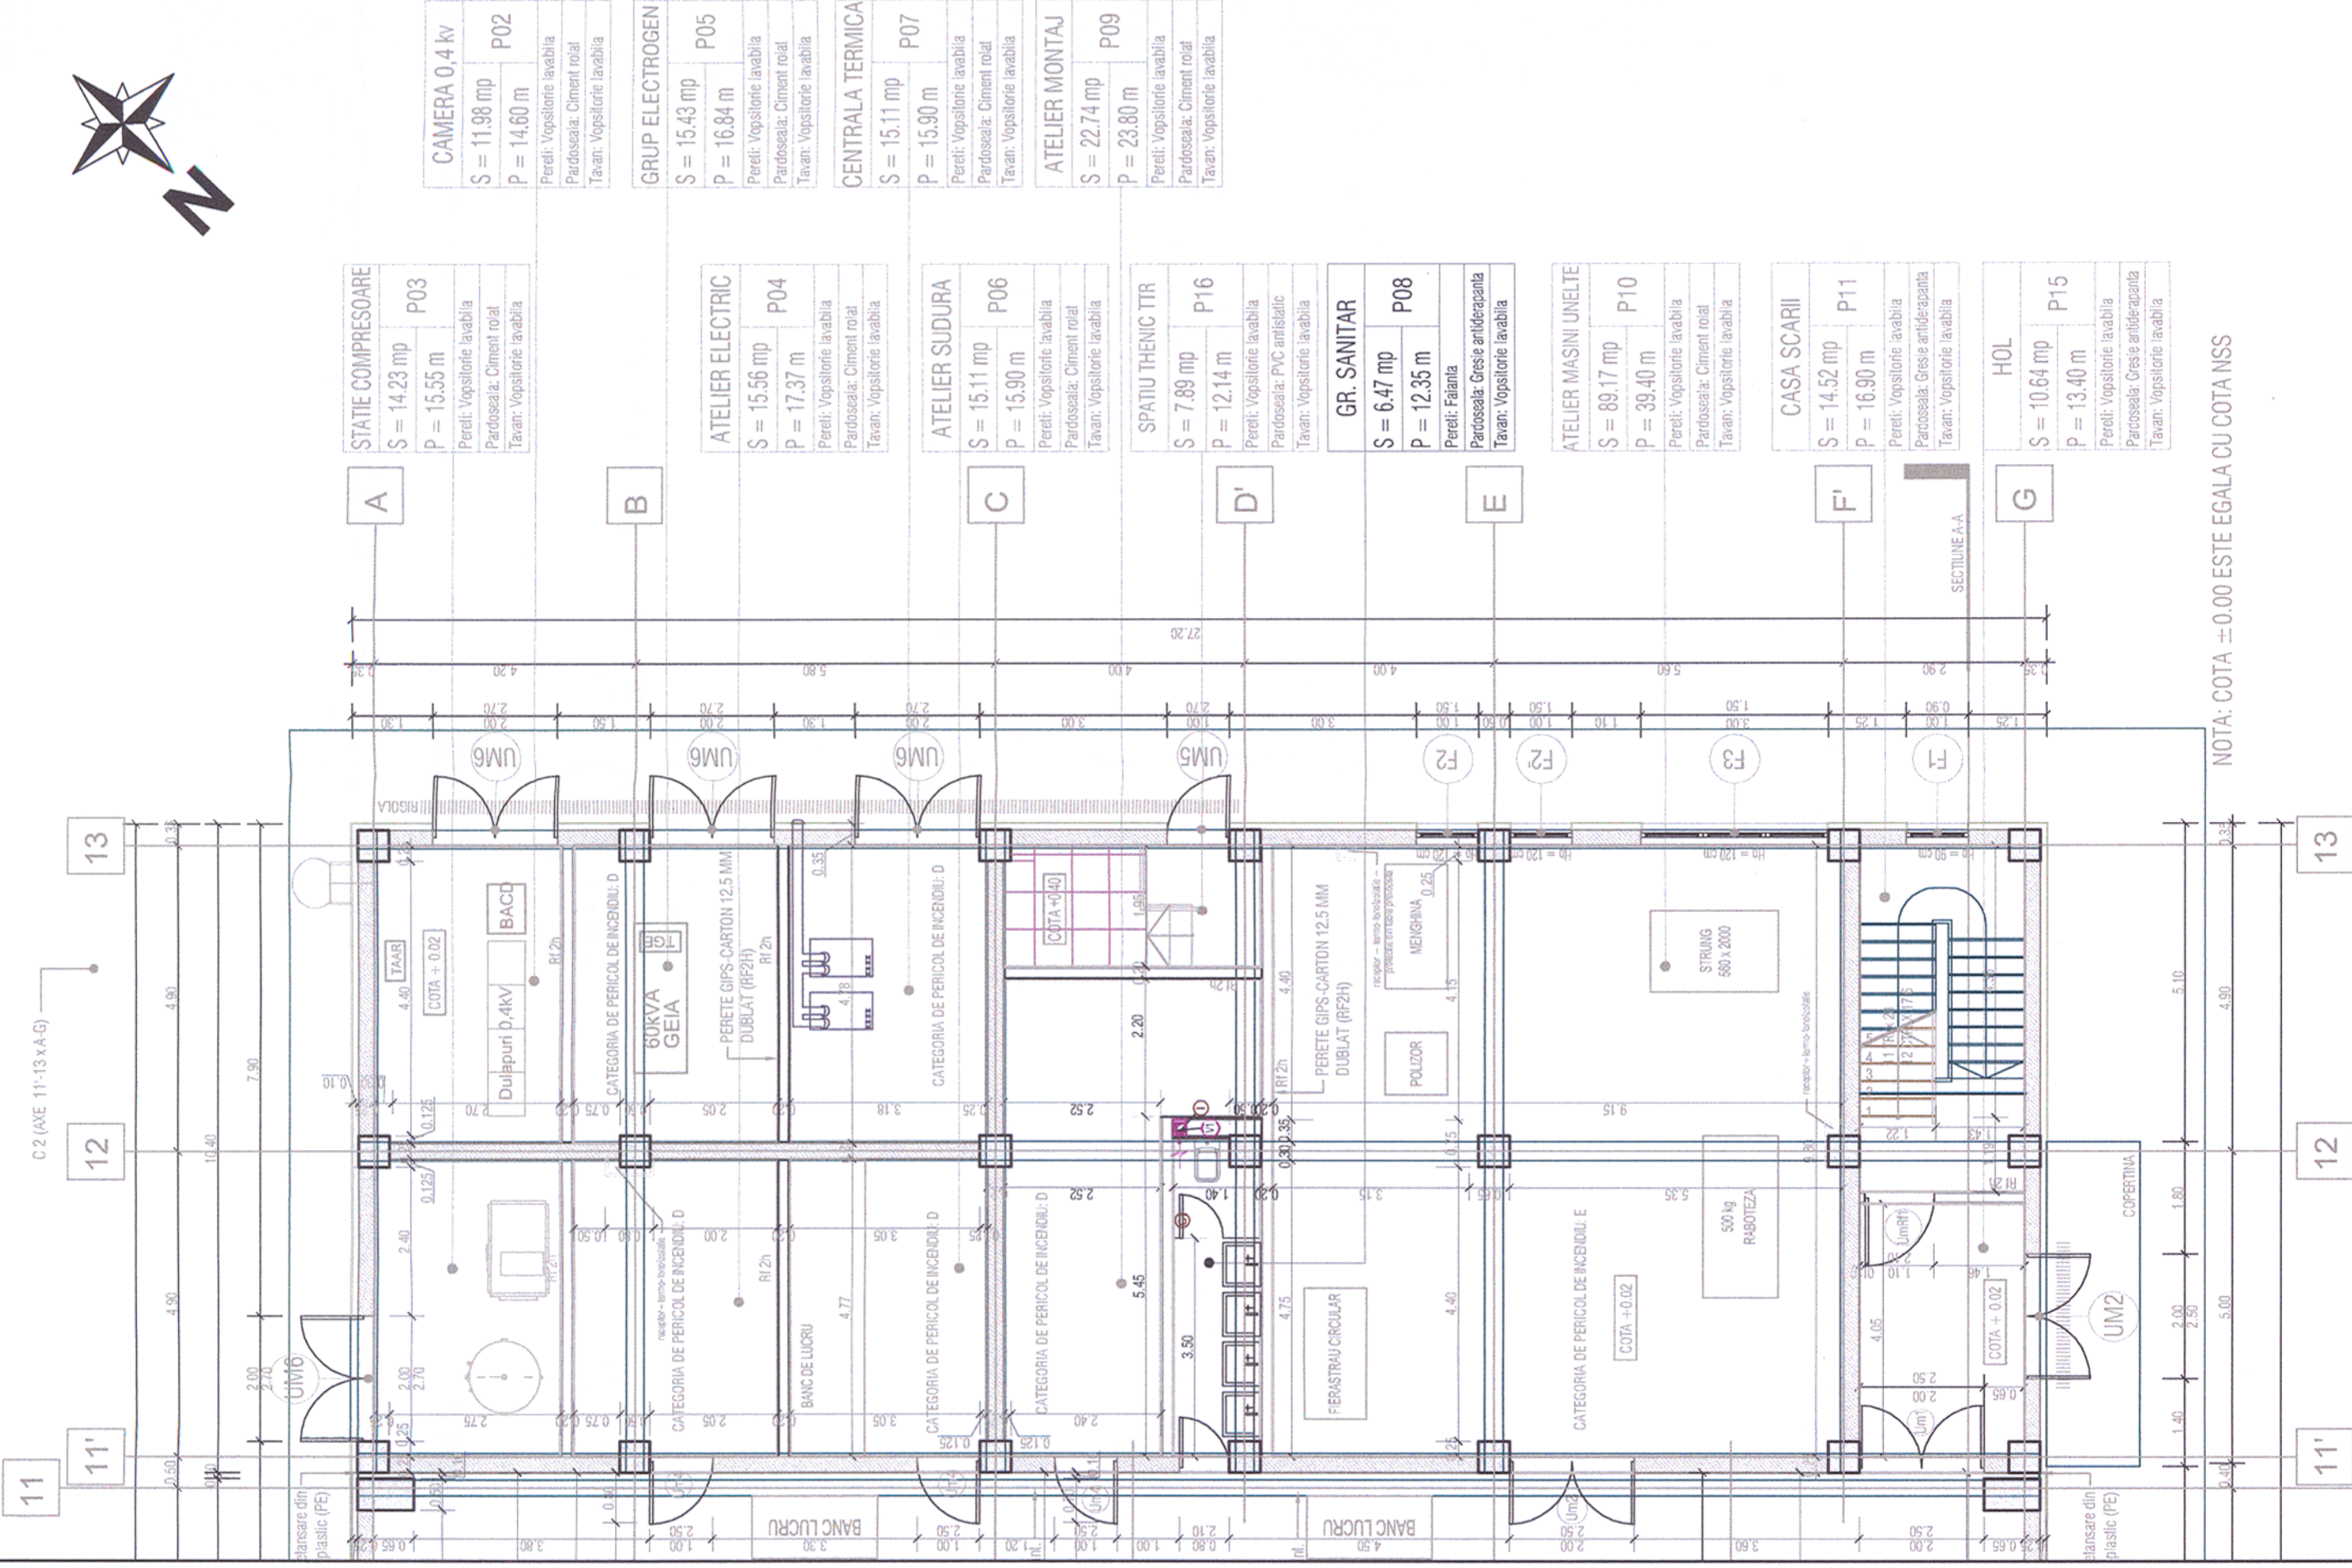

NOTA: COTA ±0.00 ESTE EGALA CU COTA NSS

<b>MINISTERUL TRANSPORTURILOR</b> BENEFICIAR / BENEFICIARY : 		Semnatura Signature 		Referat / Expertiza Report / Expertise 	
Verificator / Expert Checker / Expert 		Cerinta Requirement 		Data Date 01.2013 01.2013	
PROIECTANT / DESIGNER: 		COMPANIA NAȚIONALĂ DE CĂI FERATE "CFR" SA 		Semnatura Signature 	
Aprobat Approved Verificat Checked Subcontractant / Subcontractor	Cef de echipa Team leader Expert Cheie Key Expert	C. Teodorescu B. Goessler			
Aprobat Approved Proiectat Designed	Adjunct Sef de echipa Deputy Team leader Inginer Engineer	A.M. Baicu M.V. Iile	01.2013 01.2013	Project 9j 35311.1 Faza / Phase: PTh+CS/ TD+TS	
"Reabilitarea liniei c.f. Frontiera - Curtici - Simeria, parte componentă a coridorului IV Pan - European pentru circulația trenurilor cu viteză maximă de 160 km/h" "Rehabilitation of the Railway Line Border - Curtici - Simeria, component Part of the IV Pan - European Corridor for the Trains Circulation with maximum speed of 160 km/h" Section 2-A: km 614 - End Y Bărzava					
Denumire desen / Drawing Title: Instalații de Ventilare și Climatizare - Clădire mentenanța Radna / Ventilation and air conditioning installation - Radna Maintenance building Plan Parter - Ground Floor Plan					
Scara / Scale 1:100	Revizia / Revision -	Cod desen / Drawing Code PT.2A.03.06.IT.07.05	Nr. / No 05		