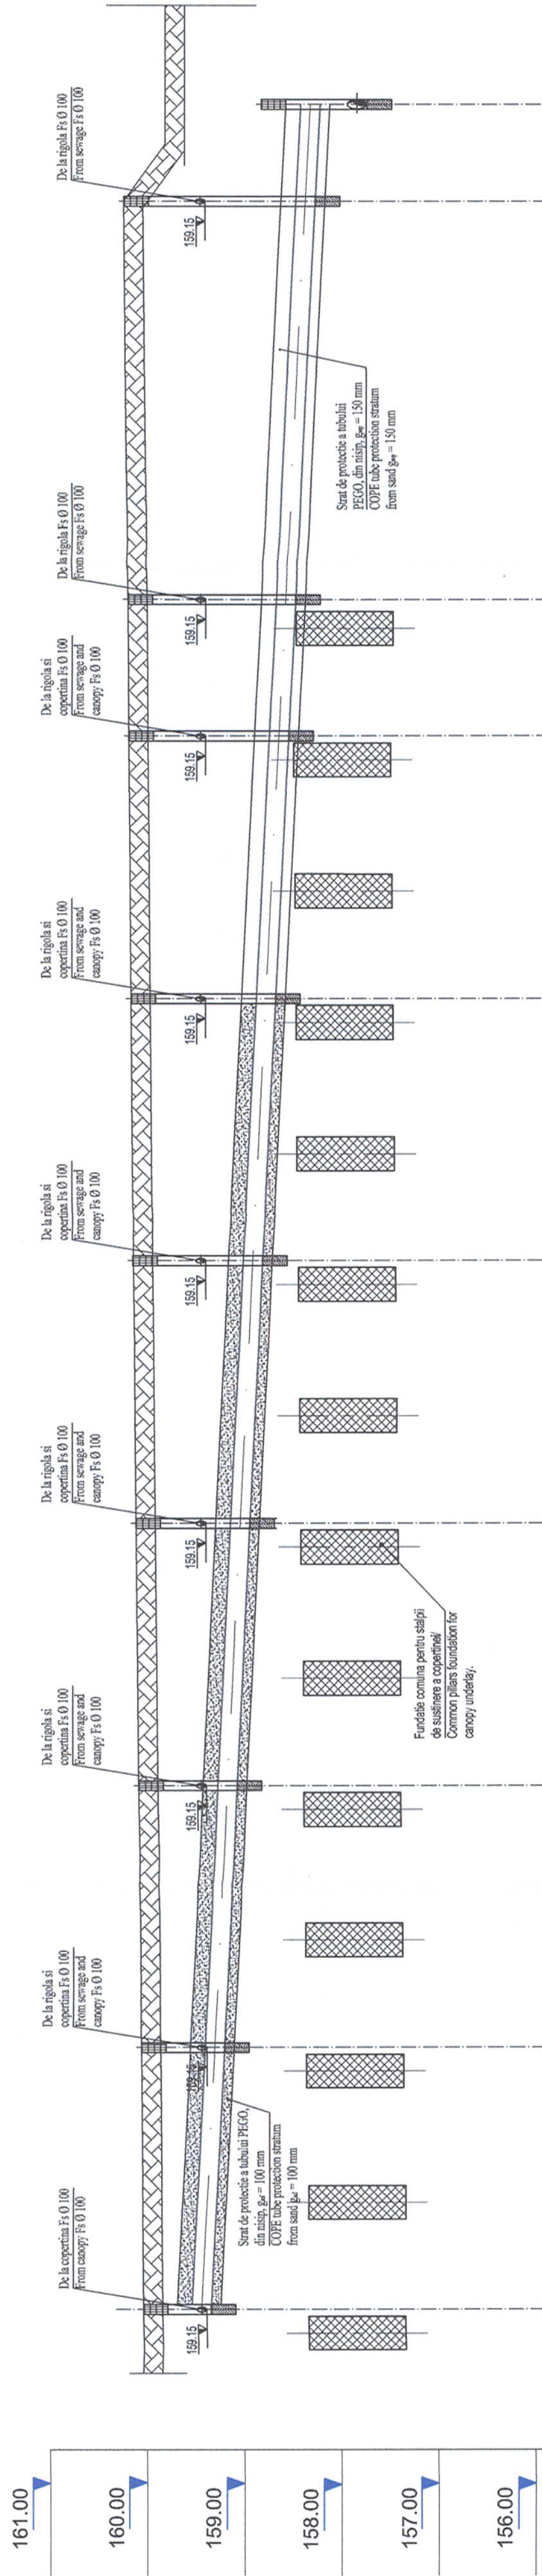


Profil longitudinal 1

Profil longitudinal 2

[illegible]

Tub PEGO, tip SN4, Ø 200 mm/
COPE tube, SN4 type, Ø 200 mm

EXECUTAREA LUCRARILOR DE MONTAJ A RETELELOR DE ALIMENTARE CU APA SI CANALIZARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTOR TIPURI DE LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR WATER SUPPLY AND SEWERAGE NETWORK WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPES OF WORKS.

Cerinta de calitate minima corespunzator nivelului de performanta este **Is** - in conformitate cu prevederile H.G. 925 - 1995.

- * Categoria de importanta a lucrarilor hidrotehnice este "**C**"
- (normala) - in conformitate cu prevederile STAS 2473 - 1983.
- * *Minimum quality requirement adequate performance level*
- are **Is** - in concordance with G.R. 925 - 1995.
- * *Importance class for hydrotechnical works is "**C**"*
- (normal) - in correspondence with STAS 2473 - 1983 forecast.

NOTA / NOTE:

- * Prezentul plan se va consulta impreuna cu planurile: PT.2C.04.16.IS.14.001 și PT.2C.04.16.IS.14.003.
* Legenda se va citi in planul: PT.2C.04.16.IS.14.001.
* The present design will be consult with the following drawings: PT.2 C.04.16.IS.14.001 and PT.2C.04.16.IS.14.003.
* The cartouche will be consult in the drawing no: PT. 2C.04.16.IS.14.001.

[illegible]