


LEGENDĂ / LEGEND

- Linii noi electrificate - Electrified new lines
  - Linii noi neelectrificate - Unelectrified new lines
  - Linii existente electrificate - Electrified existing lines
  - Linii existente neelectrificate - Unelectrified existing lines
- 
- 1X - Separator de sarcină - Switch disconnector
  - 0.12 - Separator acționat electric - Motor operated disconnector
  - Dx - Separator acționat manual - Manual operated disconnector
  - Descărcător cu ZnO - ZnO surge arrester
- 
- Fx - Siguranță fuzibilă de înaltă tensiune - High voltage fuse
  - Tx - Transformator de putere - Power transformer
  - TTx - Transformator de tensiune - Voltage transformer

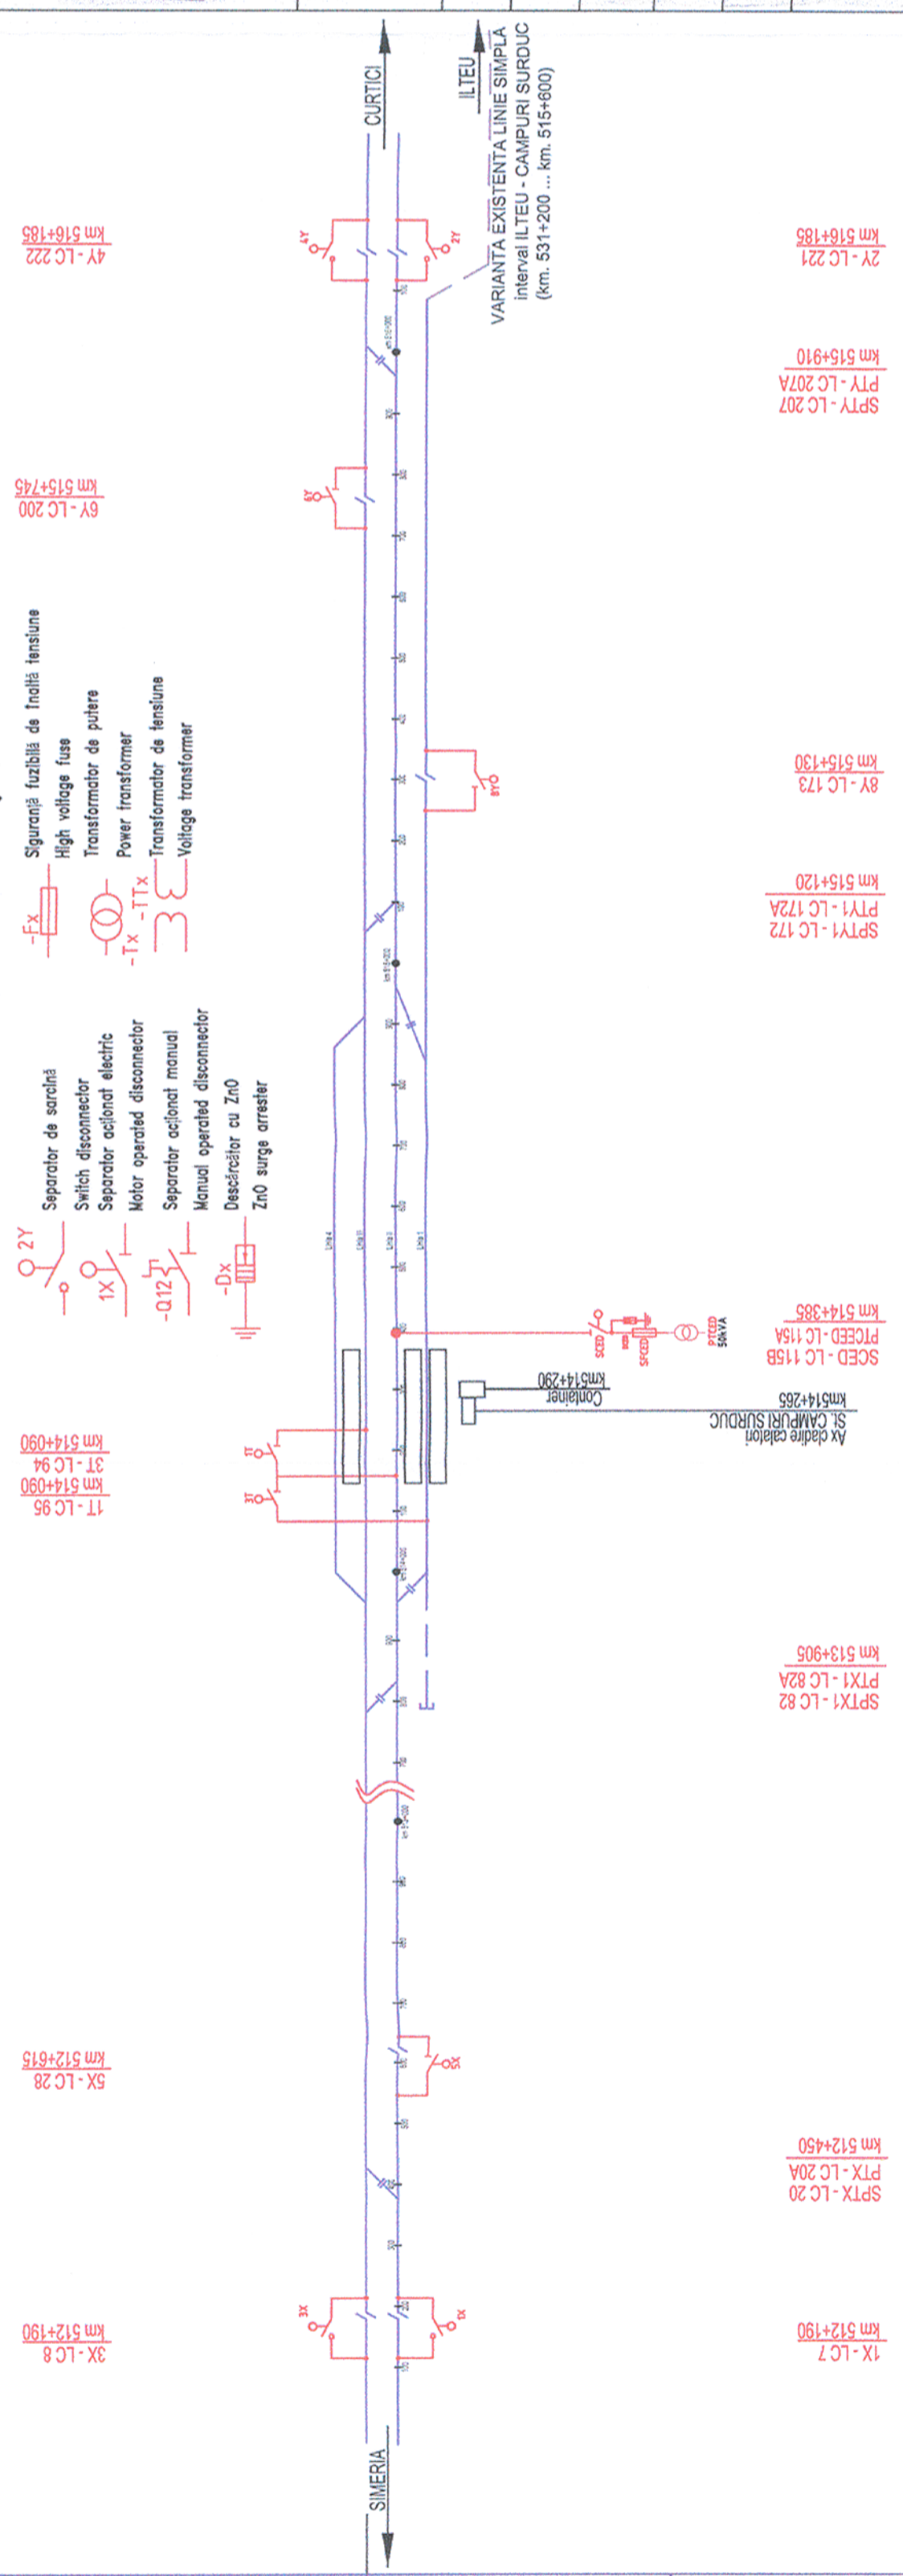

Verificator / Expert Checker / Expert	Cerința Requirement	Semnătura Signature	Referat / Expertiza Report / Expertise
<b>European Investment Bank</b>		<b>MINISTERUL TRANSPORTURILOR</b> BENEFICIAR / BENEFICIARY : 	
		COMPANIA NAȚIONALĂ DE CĂI FERATE "CFR" SA 	
PROIECTANT / DESIGNER:		Data Date	Semnătura Signature
Aprobat Approved	Sef de echipa Team leader	03.2013	
Verificat Checked	Expert Cheie Key Expert	03.2013	
Subcontractant / Subcontractor 			
Aprobat Approved	Adjunct Sef de echipa Deputy Team leader	03.2013	
Proiectat Designed	Inginer Engineer	03.2013	
"Reabilitarea liniei c.f. Frontiera - Curtici - Simeria, parte componentă a coridorului IV Pan - European pentru circulația trenurilor cu viteză maximă de 160 km/h" Tronsoanele 2 : km 614 - Gurasada "Rehabilitation of the Railway Line Border - Curtici - Simeria, component Part of the IV Pan - European Corridor for the Trains Circulation with maximum speed of 160 km/h" Sections 2 : km 614 - Gurasada		Project 9/ 35311.1 Faza / Phase: PTH+CS / TD+TS	
Denumire desen / Drawing name: CAMPURI SURDUC - Schema de sectionare si alimentare / Sectioning and supply diagram			
Scara / Scale - / -	Revizia / Revision 1/16.05.2013	Cod desen / Drawing Code PT.02.06.18.EA.010	Nr / No 01 / 03