


Profil longitudinal 5 Longitudinal profile no. 5

Profil longitudinal 6 Longitudinal profile no. 6

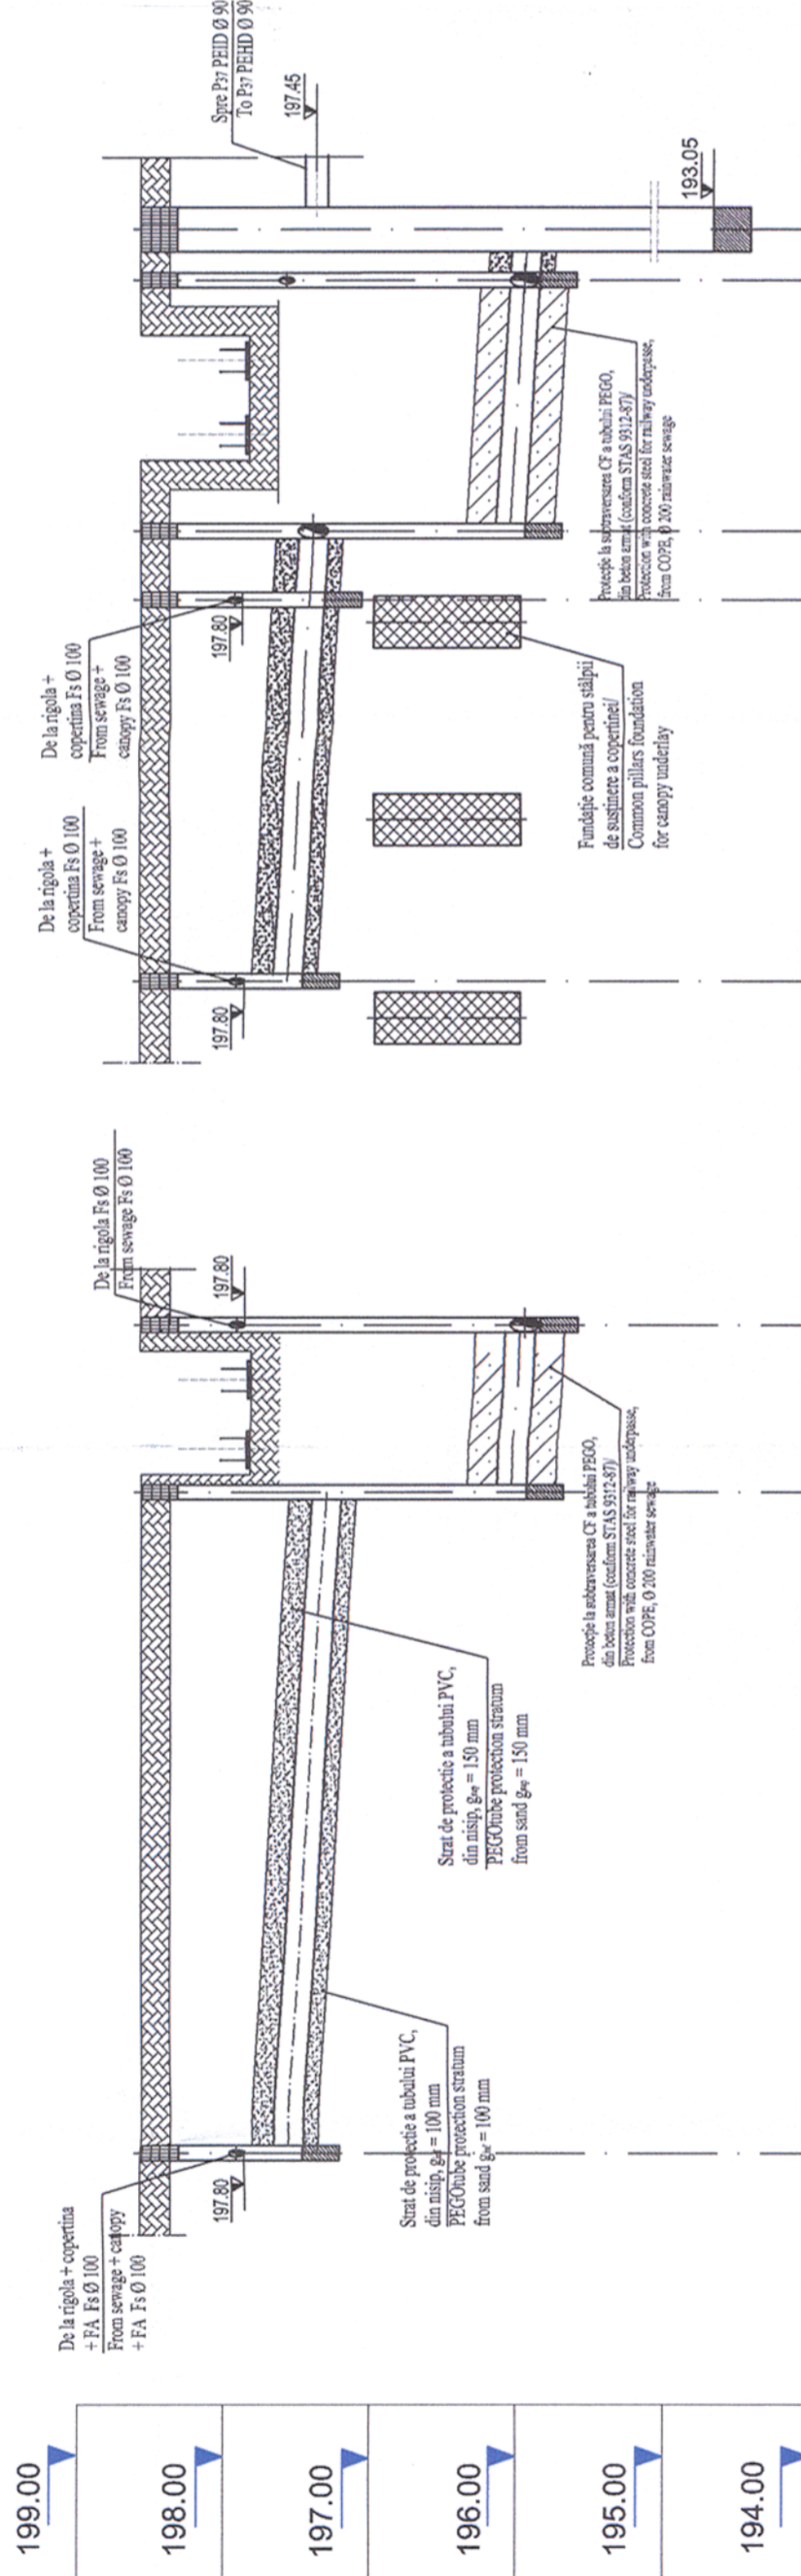

DENUMIRE CAMIN NUMBER OF CHAMBER	P ₃₄	P ₃₅	P ₃₆	P ₃₇	SPAM 1 P ₂₆
COTA TEREN AMENAJAT APPLIANCE GROUND QUOTA	197.36	197.13	197.30	197.22	198.55
COTA CAPAC CAMIN CHAMBER COVER QUOTA	198.55	198.55	198.55	198.55	198.55
COTA RADIER CAMIN (tub) CHAMBER FOUNDATION QUOTA (tube)	197.36	197.13	197.30	197.22	198.55
ADANCIME CAMIN DEPTH OF THE CHAMBER	1.19	2.62	1.25	2.62	2.71
DISTANTA INTRE CAMINE ON THE CENTER CHAMBER DISTANCE		45 m	27 m	5 m	17 m
DISTANTE CUMULATE LENGTH ADDED	0 m	45 m	72 m	77 m	94 m
PANTA TUB CANALIZARE SEWAGE SLOPE	i = 5 ‰				
MATERIAL TUB CANAL DIAMETER+TUBE MATERIAL	Tub PEGO, tip SN4, Ø 200 mm/ COPE tube, SN4 type, Ø 200 mm				

EXECUTAREA LUCRARILOR DE MONTAJ A RETELELOR DE ALIMENTARE CU APA SI CANALIZARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTOR TIPURI DE LUCRARI.

THE EXECUTION OF THE FIXING WORKS FOR WATER SUPPLY AND SEWERAGE NETWORK WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPES OF WORKS.

- * Cerinta de calitate minima corespunzator nivelului de performanta este **Is** - in conformitate cu prevederile H.G. 925 - 1995.
- * Categoria de importanta a lucrarilor hidrotehnice este **"C"** (normala)
- in conformitate cu prevederile STAS 2473 - 1983.
- * Minimum quality requirement adequate performance level are **Is** - in correspondance with G.R. 925 - 1995.
- * in correspondance with hydrotechnical works is **"C"** (normal) - in correspondance with STAS 2473 - 1983 forecast.

NOTA /NOTE:

* Prezentul plan se va consulta impreuna cu planurile: PT.03.03.28.IS.05.001, PT.03.03.28.IS.14.001, PT.03.03.28.IS.14.002, PT.03.03.28.IS.14.003, PT.03.03.28.IS.14.005 si PT.03.03.28.IS.14.006.

* Legenda se va citi in planul: PT.03.03.28.IS.14.001.

*The present design will be consult with the following drawings:

PT.03.03.28.IS.07.001, PT.03.03.28.IS.14.001, PT.03.03.28.IS.14.002,

PT.03.03.28.IS.14.003, PT.03.03.28.IS.14.005 and PT.03.03.28.IS.14.006,

* The cartouche will be consult in the drawing no: PT.03.03.28.IS.14.001.

Verificator/ Expert Checker/ Expert	Centina/ Requirement	Semnatura/ Signature	Referat/ Expertiza Report/ Expertise		
PROIECTANT / DESIGNER:				Date / Date	Semnatura Signature
Aprobat Approved	Sef de echipa Team leader	C. Teodorescu		01.2013	
Verificat Checked	Expert Cheie Key Expert	B. Goessler		01.2013	
Subcontractant / Subcontractor					
Aprobat Approved		Adjunct Sef de echipa Deputy Team leader	A.M. Baicu	01.2013	
Proiectat Designed		Proiectant Designer	Fi. Duta	01.2013	
"Reabilitarea liniei c.f. Frontiera - Curtici - Simeria, parte componenta a Coridorului IV Pan - European pentru circulatia trenurilor cu viteza maxima de 160 km/h" Tronsoanel 3: Gurasada - Simeria/ LOT 3					
"Reabilitarea liniei c.f. Simeria - Curtici - Simeria, componenta Part of the IV Pan - European Corridor for the Trains Circulation with maximum speed of 160 km/h" Section 3: Gurasada - Simeria/ LOT 3					
Denumire desen / Drawing Title : Statia CFR SIMERIA. Retea exteriora de canalizare pluviala. Profile longitudinale prin canalizare 5 - 6. SIMERIA Railway Station. Rainwater sewerage network. Longitudinal profile no. 5 - 6.					
Scara / Scale Oriz - 1: 500; Vert. - 1: 50	Revizii/Revision	Cod desen / Drawing Code PT.03.03.28.IS.14.004		Nr / No	